



464 Valley Brook Avenue, Lyndhurst NJ 07071
129 Sea Girt Avenue, Manasquan NJ 08736
Phone: (800) 423-0766 • Fax: (201) 438-1798
www.mccabeenv.com

LEAD IN DRINKING WATER TESTING REPORT

Conducted for:

Bayonne Board of Education
669 Avenue A
Bayonne, New Jersey 07002

Conducted at:

Horace Mann Community School
25 W 38th Street
Bayonne, New Jersey 07002

Submitted by:

McCabe Environmental Services, L.L.C.
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

REPORT DATE: October 25, 2022

MES PROJECT NO.: 22-04448

Prepared by:

A handwritten signature in blue ink, appearing to read 'Brandon Soto'.

Brandon Soto
Environmental Scientist

Signed for the Company by:

A handwritten signature in blue ink, appearing to read 'John H. Chiaviello'.

John H. Chiaviello
Vice President

TABLE OF CONTENTS

	Page
1.0 INTRODUCTION	1
2.0 SCOPE OF WORK.....	1
3.0 PROCEDURES.....	1
4.0 TABLE OF SAMPLE RESULTS	2
5.0 DISCUSSION AND CONCLUSION	3

APPENDIX A

Laboratory Certificates of Analysis
&
Sample Chain of Custody Forms

APPENDIX B

School District Sampling Attachments

1.0 INTRODUCTION

McCabe Environmental Services, L.L.C. (McCabe) was retained by Bayonne Board of Education (Client) to conduct lead in drinking water testing at Horace Mann Community School located at 25 W 38th Street, Bayonne, New Jersey 07002.

The project information is as follows:

<u>Client Name:</u>	Bayonne Board of Education
<u>Contact Person:</u>	Mr. Daniel Castles
<u>Project Name:</u>	Horace Mann Community School – Lead in Drinking Water
<u>Project Location:</u>	25 W 38 th Street Bayonne, New Jersey 07002
<u>Date(s) of Service:</u>	September 1, 2022
<u>McCabe Personnel:</u>	Gary Clare, Gerard D'Alessio & Brandon Soto

2.0 SCOPE OF WORK

Drinking water testing was performed at Horace Mann Community School on September 1, 2022. The purpose of the testing was to determine if the building's plumbing was having an adverse impact on water quality, specifically with regard to lead concentrations. Samples were collected from various potential drinking water outlets located throughout the building. Testing was followed as per past reports provided by Bayonne Board of Education. Locations were also added in certain schools as per Scott Nolan's request.

3.0 PROCEDURES

After determining which outlets would be sampled, McCabe personnel collected a "first draw" sample at each location. A "first draw" is the initial water that is first to come out of the tap after a period of inactivity. Following the "first draw", a "30 second flush" sample was also collected closest to where the main service line comes into the building. All samples were collected into 250 mL sterile bottles, labeled with a sample identification, and analyzed in accordance with EPA approved methods to determine the level of lead in drinking water. Samples were analyzed by an accredited laboratory.

The U.S. Environmental Protection Agency (EPA) has established National Primary Drinking Water Regulations (NPDWR) that set mandatory water quality standards for drinking water contaminants. These are enforceable standards called "maximum contaminant levels" or "MCL", which are established to protect the public against consumption of drinking water contaminants that present a risk to human health. An MCL is the maximum allowable amount of a contaminant in drinking water which is delivered to the consumer.

The EPA has established the Lead and Copper Rule that sets standards for state and public water systems. This rule has set an MCL for lead at 15 parts per billion (ppb) for a one liter sample. However, the EPA also established the Lead in Drinking Water at Schools and Child Care Facilities in which the EPA recommends an MCL of 20 ppb for a 250 milliliter first draw sample. In order to be more stringent, for our report purposes we have compared all results to both the 15 ppb and the 20 ppb standards.

4.0 TABLE OF SAMPLE RESULTS

The following table presents all sample results in order of sample identification:

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)
HM-01	First Draw – Room B4 (PTA) Faucet	13.4	Pass	Pass
HM-02	30 Second Flush – Room B4 (PTA) Faucet	1.2	Pass	Pass
HM-03	First Draw – Basement Bubbler by Elevator – Left	0.8	Pass	Pass
HM-04	First Draw – Basement Bubbler by Elevator – Right	0.9	Pass	Pass
HM-05	First Draw – Room B1 Faucet	2.9	Pass	Pass
HM-06	First Draw – Room B11 Faucet	2	Pass	Pass
HM-07	First Draw – Room 102 Faucet	9.6	Pass	Pass
HM-08	30 Second Flush – Room 102 Faucet	1.8	Pass	Pass
HM-09	First Draw – Bubbler by Room 101	12.2	Pass	Pass
HM-10	First Draw – Room 101 Faucet	3.6	Pass	Pass
HM-11	First Draw – Bubbler by Office	11.5	Pass	Pass
HM-12	First Draw – Room 114 Faucet	1.2	Pass	Pass
HM-13	First Draw – Teacher Café Water Fountain	1.7	Pass	Pass
HM-14	First Draw – Teacher Café Faucet	0.5	Pass	Pass
HM-15	First Draw – Nurse’s Office Faucet	1.4	Pass	Pass
HM-16	First Draw – Room 109 Faucet	3.2	Pass	Pass
HM-17	First Draw – Bubbler by Room 204	19.5	Fail	Pass
HM-18	First Draw – Bubbler by Room 217	13.1	Pass	Pass
HM-19	First Draw – Bubbler by 213	8.8	Pass	Pass
HM-20	First Draw – Bubbler by 303	16.3	Fail	Pass

Sample ID	Sample Location	Lead Result	Exceeds (MCL 15 ppb)	Exceeds (MCL 20 ppb)
HM-21	First Draw – bubbler by 317	9	Pass	Pass

5.0 DISCUSSION AND CONCLUSION

A total of twenty-one (21) samples were collected from Horace Mann Community School located at 25th W 38th Street, Bayonne, New Jersey 07002. Two (2) samples were found to be greater than the EPA Lead and Copper Rule standard of 15 ppb but were below 20 ppb. All other samples were found to be less than the EPA standards of 20 ppb and 15 ppb.

McCabe recommends discontinued usage of the following outlets which resulted in failed results until additional samples can be collected and analyzed and a permanent solution can be recommended:

- **Bubbler by Room 204**
- **Bubbler by Room 303**

Proper signage shall be posted at the Library Office Sink identifying “Do Not Drink, Safe For Washing Hands.” This sign can be found in Appendix B.

To address the water quality in the short term, McCabe recommends that it may be appropriate to inspect piping near these fixtures to determine if any corrosion is evident and whether it is possible to replace portions of the piping.

In addition, McCabe Environmental recommends annual drinking water sampling to ensure that the building’s plumbing is not having an adverse impact on water quality.

APPENDIX A

**LABORATORY CERTIFICATES OF ANALYSIS
&
SAMPLE CHAIN OF CUSTODY FORMS**



Monday, September 12, 2022

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
SDG ID: GCM21486
Sample ID#s: CM21486 - CM21506

This laboratory is in compliance with the NELAC requirements of procedures used except where indicated.

This report contains results for the parameters tested, under the sampling conditions described on the Chain Of Custody, as received by the laboratory. This report is incomplete unless all pages indicated in the pagination at the bottom of the page are included.

A scanned version of the COC form accompanies the analytical report and is an exact duplicate of the original.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200. The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Sincerely yours,

A handwritten signature in black ink, appearing to read "Phyllis Shiller".

Phyllis Shiller

Laboratory Director

NELAC - #NY11301
CT Lab Registration #PH-0618
MA Lab Registration #M-CT007
ME Lab Registration #CT-007
NH Lab Registration #213693-A,B

NJ Lab Registration #CT-003
NY Lab Registration #11301
PA Lab Registration #68-03530
RI Lab Registration #63
VT Lab Registration #VT11301



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Sample Id Cross Reference

September 12, 2022

SDG I.D.: GCM21486

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION

Client Id	Lab Id	Matrix
HM-01	CM21486	DRINKING WATER
HM-02	CM21487	DRINKING WATER
HM-03	CM21488	DRINKING WATER
HM-04	CM21489	DRINKING WATER
HM-05	CM21490	DRINKING WATER
HM-06	CM21491	DRINKING WATER
HM-07	CM21492	DRINKING WATER
HM-08	CM21493	DRINKING WATER
HM-09	CM21494	DRINKING WATER
HM-10	CM21495	DRINKING WATER
HM-11	CM21496	DRINKING WATER
HM-12	CM21497	DRINKING WATER
HM-13	CM21498	DRINKING WATER
HM-14	CM21499	DRINKING WATER
HM-15	CM21500	DRINKING WATER
HM-16	CM21501	DRINKING WATER
HM-17	CM21502	DRINKING WATER
HM-18	CM21503	DRINKING WATER
HM-19	CM21504	DRINKING WATER
HM-20	CM21505	DRINKING WATER
HM-21	CM21506	DRINKING WATER



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

8:58
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21486

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-01

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	13.4	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

8:59
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21487

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-02

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.2	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:00
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21488

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-03

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.8	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:02
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21489

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-04

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.9	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:04
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21490

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-05

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2.9	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:04
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21491

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-06

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	2	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:10
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21492

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-07

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	9.6	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:12
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21493

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-08

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.8	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:15
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21494

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-09

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	12.2	0.5	2	ppb	15			09/09/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:18
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21495

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-10

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	3.6	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:20
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21496

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-11

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	11.5	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:22
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21497

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-12

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.2	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:25
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21498

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-13

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.7	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:27
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21499

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-14

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	0.5	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:29
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21500

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-15

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	1.4	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:32
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21501

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-16

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	3.2	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:36
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21502

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-17

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	19.5	0.5	2	ppb	15			09/10/22	MGH	E200.8
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:38
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21503

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-18

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	13.1	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:40
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21504

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-19

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	8.8	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:42
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21505

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-20

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	16.3	0.5	2	ppb	15			09/10/22	MGH	E200.8
*** Lead exceeds Action Level of 15 ***										
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Report

September 12, 2022

FOR: Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071

Sample Information

Matrix: DRINKING WATER
Location Code: MCCABE-PB
Rush Request: Standard
P.O.#:

Custody Information

Collected by: GD
Received by: CP
Analyzed by: see "By" below

Date

09/01/22
09/01/22

Time

9:45
18:30

Laboratory Data

SDG ID: GCM21486
Phoenix ID: CM21506

Project ID: 22-04448 BAYONNE BOARD OF EDUCATION
Client ID: HM-21

Parameter	Result	RL/ PQL	DIL	Units	AL	MCL	MCLG	Date/Time	By	Reference
Lead	9	0.5	2	ppb	15			09/10/22	MGH	E200.8
Total Metal Digestion	Completed							09/06/22	AG	E200.8

RL/PQL=Reporting/Practical Quantitation Level DIL=Dilution (analysis required diluting to evaluate) ND=Not Detected
BRL=Below Reporting Level (less than the reporting level, the lowest amount the laboratory can detect and report.)
AL = Action Level MCL = Maximum Contaminant Level MCLG = Maximum Contaminant Level Goal

Comments:

Action Level (AL): 40 CFR Part 141.80 Lead & Copper ALs.

If you are the client above and have any questions concerning this testing, please do not hesitate to contact Phoenix Client Services at ext.200.
The contents of this report cannot be discussed with anyone other than the client listed above without their written consent.

Phyllis Shiller, Laboratory Director

September 12, 2022

Reviewed and Released by: Anil Makol, Project Manager

Analysis Report - Summary

September 12, 2022

Attn: Jarred Panecki
McCabe Environmental Services, LLC
464 Valley Brook Avenue
Lyndhurst, New Jersey 07071



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823

SDG I.D.: GCM21486



Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
Project: 22-04448 Bayonne Board Of Education								
CM21486	HM-01	09/01/22	Lead	13.4	0.5	ppb	09/09/22	E200.8
CM21487	HM-02	09/01/22	Lead	1.2	0.5	ppb	09/09/22	E200.8
CM21488	HM-03	09/01/22	Lead	0.8	0.5	ppb	09/09/22	E200.8
CM21489	HM-04	09/01/22	Lead	0.9	0.5	ppb	09/09/22	E200.8
CM21490	HM-05	09/01/22	Lead	2.9	0.5	ppb	09/09/22	E200.8
CM21491	HM-06	09/01/22	Lead	2	0.5	ppb	09/09/22	E200.8
CM21492	HM-07	09/01/22	Lead	9.6	0.5	ppb	09/09/22	E200.8
CM21493	HM-08	09/01/22	Lead	1.8	0.5	ppb	09/09/22	E200.8
CM21494	HM-09	09/01/22	Lead	12.2	0.5	ppb	09/09/22	E200.8
CM21495	HM-10	09/01/22	Lead	3.6	0.5	ppb	09/10/22	E200.8
CM21496	HM-11	09/01/22	Lead	11.5	0.5	ppb	09/10/22	E200.8
CM21497	HM-12	09/01/22	Lead	1.2	0.5	ppb	09/10/22	E200.8
CM21498	HM-13	09/01/22	Lead	1.7	0.5	ppb	09/10/22	E200.8
CM21499	HM-14	09/01/22	Lead	0.5	0.5	ppb	09/10/22	E200.8
CM21500	HM-15	09/01/22	Lead	1.4	0.5	ppb	09/10/22	E200.8
CM21501	HM-16	09/01/22	Lead	3.2	0.5	ppb	09/10/22	E200.8
CM21502	HM-17	09/01/22	Lead	19.5	0.5	ppb	09/10/22	E200.8
CM21503	HM-18	09/01/22	Lead	13.1	0.5	ppb	09/10/22	E200.8
CM21504	HM-19	09/01/22	Lead	8.8	0.5	ppb	09/10/22	E200.8
CM21505	HM-20	09/01/22	Lead	16.3	0.5	ppb	09/10/22	E200.8
CM21506	HM-21	09/01/22	Lead	9	0.5	ppb	09/10/22	E200.8

Sample	Client Id	Col Date	Parameter	Result	RL	Units	Date Analyzed	Reference
--------	-----------	-------------	-----------	--------	----	-------	------------------	-----------

Comments:

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

ND=Not detected BDL=Below Detection Level RL=Reporting Level CL=Client Limit



Phyllis Shiller
Laboratory Director
September 12, 2022



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



QA/QC Report

September 12, 2022

QA/QC Data

SDG I.D.: GCM21486

Parameter	Blank	Blk RL	Sample Result	Dup Result	Dup RPD	LCS %	LCSD %	LCS RPD	MS %	MSD %	MS RPD	% Rec Limits	% RPD Limits
-----------	-------	-----------	------------------	---------------	------------	----------	-----------	------------	---------	----------	-----------	--------------------	--------------------

QA/QC Batch 640735A (mg/L), QC Sample No: CM21485 2X (CM21486, CM21487, CM21488, CM21489, CM21490, CM21491, CM21492, CM21493, CM21494)

ICP MS Metals - Aqueous

Lead	BRL	0.0001				105			98.0				
------	-----	--------	--	--	--	-----	--	--	------	--	--	--	--

Comment:

This batch does not include a duplicate.

QA/QC Batch 640736 (mg/L), QC Sample No: CM21495 2X (CM21495, CM21496, CM21497, CM21498, CM21499, CM21500, CM21501, CM21502, CM21503, CM21504)

ICP MS Metals - Aqueous

Lead	BRL	0.0001	0.0036	0.0036	0	103			99.6				
------	-----	--------	--------	--------	---	-----	--	--	------	--	--	--	--

QA/QC Batch 640736A (mg/L), QC Sample No: CM21505 2X (CM21505, CM21506)

ICP MS Metals - Aqueous


Lead	BRL	0.0001				103			100				
------	-----	--------	--	--	--	-----	--	--	-----	--	--	--	--

Comment:

This batch does not include a duplicate.

If there are any questions regarding this data, please call Phoenix Client Services at extension 200.

RPD - Relative Percent Difference
LCS - Laboratory Control Sample
LCSD - Laboratory Control Sample Duplicate
MS - Matrix Spike
MS Dup - Matrix Spike Duplicate
NC - No Criteria
Intf - Interference


Phyllis Shiller, Laboratory Director
September 12, 2022

Monday, September 12, 2022

Criteria: NJ: DW

State: NJ

Sample Criteria Exceedances Report

GCM21486 - MCCABE-PB

SampNo	Acode	Phoenix Analyte	Criteria	Result	RL	Criteria	RL Criteria	Analysis Units
CM21502	PB-DW-MS	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	19.5	0.5	15	1	ppb
CM21505	PB-DW-MS	Lead	EPA / 40 CFR 141 DW / 141.80 Lead & Copper ALs	16.3	0.5	15	1	ppb

Phoenix Laboratories does not assume responsibility for the data contained in this exceedance report. It is provided as an additional tool to identify requested criteria exceedences. All efforts are made to ensure the accuracy of the data (obtained from appropriate agencies). A lack of exceedence information does not necessarily suggest conformance to the criteria. It is ultimately the site professional's responsibility to determine appropriate compliance.



Environmental Laboratories, Inc.
587 East Middle Turnpike, P.O.Box 370, Manchester, CT 06045
Tel. (860) 645-1102 Fax (860) 645-0823



Analysis Comments

September 12, 2022

SDG I.D.: GCM21486

The following analysis comments are made regarding exceptions to criteria not already noted in the Analysis Report or QA/QC Report: None.

ENVIRONMENTAL SERVICES, L.L.C.

100 BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201) 438-4839 FAX: (201) 438-1798

2.5°C WUP

LEAD in DRINKING WATER

CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Horace Mann Community School 25 W 38th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard D'Alessio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 09/01/22		

MES PROJECT #	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	HM-01	First draw - Room 34C PTA's Faucet	08:58	LEAD - 200.8
DW	HM-02	30 second flush - Room 34C PTA's Faucet	08:59	LEAD - 200.8
DW	HM-03	First draw ^{Posterior} Bubblers by Elevator - Left	09:00	LEAD - 200.8
DW	HM-04	First draw ^{Posterior} Bubblers by Elevator - Right	09:02	LEAD - 200.8
DW	HM-05	First draw - Room 101 Bubblers Faucet	09:04	LEAD - 200.8
DW	HM-06	First draw - Room 101 faucet	09:04	LEAD - 200.8
DW	HM-07	First draw - Room 102 faucet	09:10	LEAD - 200.8
DW	HM-08	30 second flush - Room 102 faucet	09:12	LEAD - 200.8
DW	HM-09	First draw - bubbler by Room 101	09:15	LEAD - 200.8
DW	HM-10	First draw - Room 101 faucet	09:18	LEAD - 200.8

Relinquished by (Print) Gerard D'Alessio	Date:	Time:	Received by: (Print) Barbara Caffrey	Date:	Time:
Signature:			Signature:		
Relinquished by (Print) Barbara Caffrey	Date:	Time:	Received by: (Print)	Date:	Time:
Signature:			Signature: Emily JA	9/1/22	1830

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

MCCABE ENVIRONMENTAL SERVICES, L.L.C.

464 VALLEY BROOK AVENUE LYNDHURST, NJ 07071 • PHONE: (201)438-4839 FAX: (201)438-1798

2.5°C wip

LEAD in DRINKING WATER

CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Horace Mann Community School 25 W 38th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard D'Alesio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 09/01/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	HM-11	Bubbler by office - first draw	0920	LEAD - 200.8
DW	HM-12	First draw - Room 114 faucet	0922	LEAD - 200.8
DW	HM-13	First draw - Teacher cafe water fountain	0925	LEAD - 200.8
DW	HM-14	First draw - Teacher cafe faucet	0927	LEAD - 200.8
DW	HM-15	First draw - Nurse's office faucet	0929	LEAD - 200.8
DW	HM-16	First draw - Room 109 faucet	0932	LEAD - 200.8
DW	HM-17	First draw - Room 204 Bubbler by Room 204	0936	LEAD - 200.8
DW	HM-18	First draw - Bubbler by Room 217	0938	LEAD - 200.8
DW	HM-19	First draw - Bubbler by 213	0940	LEAD - 200.8
DW	HM-20	First draw - Bubbler by 303	0942	LEAD - 200.8

Relinquished by (Print) Gerard D'Alesio	Date:	Time:
Signature: <i>Gerard D'Alesio</i>	Received by: (Print) <i>Emily</i>	Time: 7/22 2022
Relinquished by (Print) <i>Emily</i>	Date:	Time:
Signature: <i>Emily</i>	Received by: (Print) <i>Emily</i>	Time: 9/1/22 1830

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

McCabe Environmental Services, L.L.C.

464 Valley Brook Avenue Lynnhurst, NJ 07071 • Phone: (201) 438-4839 Fax: (201) 438-1798

2.50 w/cip

LEAD in DRINKING WATER CHAIN-OF-CUSTODY FORM

CLIENT NAME: Bayonne Board of Education		SITE ADDRESS: Horace Mann Community School 25 W 38th St, Bayonne, NJ 07002	
FIELD INSPECTOR'S NAME: Gerard D'Alipio		TURNAROUND TIME REQUESTED: 2-Week	
MES PROJECT #: 22-04448	SAMPLE DATE: 09/01/22		

Matrix	SAMPLE ID	SAMPLE LOCATION	TIME COLLECTED	ANALYSIS REQUESTED
DW	HM-21	First draw - bubbler by 3/7	0945	LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8
DW				LEAD - 200.8

21500

Relinquished by (Print) Gerard D'Alipio	Date:	Time:	Received by: (Print) Gerard D'Alipio	Date:	Time:
Signature: Gerard D'Alipio			Signature: Gerard D'Alipio		
Relinquished by (Print) Gerard D'Alipio	Date:	Time:	Received by: (Print) Gerard D'Alipio	Date:	Time:
Signature: Gerard D'Alipio			Signature: Gerard D'Alipio		

Laboratory Analysis Performed by (Analyst Signature, Laboratory Name & Location): Phoenix Environmental Laboratories

APPENDIX B

**SCHOOL DISTRICT SAMPLING
ATTACHMENTS**

Attachment A - List of Priority for Sampling

SCHOOL NAME	DATE OF SAMPLING	CERTIFIED LABORATORY	NOTES
Horace Mann Community School	09/01/2022	Phoenix Environmental Laboratories Inc.	

Attachment B – Plumbing Profile

Note: Complete for each school. For additional information see the USEPA publication, "The 3Ts for Reducing Lead in Drinking Water in Schools"

Name of School: Horace Mann Community School Levels: K-8

Address: 25 West 38th St., Bayonne, NJ 07002

Individual school project officer Signature: *Scott Nelson* Date: August 2002

Questions	Answers				
Background Information					
1. What year was the original building constructed? Were any buildings or additions added to the original facility?	K-8 Grade School Built in 1914 K-8 Grade School addition 1924				
2. If the building was constructed or repaired after 1986, was lead-free plumbing and solder utilized? What type of solder was used? Document all locations where lead solder was used.	Any repairs made after 1986 were done using lead free solder				
3. Where are the most recent plumbing repairs and replacements?	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">Location: Nurses Office 1st Floor Teachers Room Art Room</td> <td style="width: 50%;">Description: Replacement faucet Replacement faucet Replacement faucet</td> </tr> </table>	Location: Nurses Office 1st Floor Teachers Room Art Room	Description: Replacement faucet Replacement faucet Replacement faucet		
Location: Nurses Office 1st Floor Teachers Room Art Room	Description: Replacement faucet Replacement faucet Replacement faucet				
4. With what materials is the service connection (the pipe that carries water to the school from the public water system's main in the street) made? Where is the Service Line located? (This is the POE location.)	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td colspan="2">Material: Main Building - Duct Iron</td> </tr> <tr> <td colspan="2">Location: The water main (39th St) enters near room B-4 (PTA room) where the water meter is located and continues to the remainder of the building</td> </tr> </table>	Material: Main Building - Duct Iron		Location: The water main (39th St) enters near room B-4 (PTA room) where the water meter is located and continues to the remainder of the building	
Material: Main Building - Duct Iron					
Location: The water main (39th St) enters near room B-4 (PTA room) where the water meter is located and continues to the remainder of the building					
5. Is there point of entry (POE) or point of use (POU) treatment in use?	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">Y / N No treatment of water Type: at POE</td> <td style="width: 50%;">Main building 1924 Location:</td> </tr> <tr> <td colspan="2">City water comes treated</td> </tr> </table>	Y / N No treatment of water Type: at POE	Main building 1924 Location:	City water comes treated	
Y / N No treatment of water Type: at POE	Main building 1924 Location:				
City water comes treated					

Questions	Answers
6. Are there tanks in your plumbing system (pressure tanks, gravity storage tanks)?	Y / N Yes Building has a 75 gallon hot water storage tank located in the boiler room
7. Does the school have a filter maintenance and operation program? If so, who is responsible for this program? What is the process for adding filters?	Yes, Scott Nolan, Andy McCabe, Vinny Caiola, change filters on an as needed basis assign plumbers
8. Have accessible screens or aerators on outlets that provide drinking water been cleaned? Does the school have a screen or aerator maintenance program?	Y / N Yes The district has set-up a routine maintenance program to clean screens
9. Have there been any complaints about bad (metallic) taste? Note location(s).	Y / N NO Location:
10. Review records and consult with the public water supplier to determine whether any water samples have been taken in the building for any contaminants. If so, identify: <ul style="list-style-type: none"> • Name of contaminant(s) • Concentrations found • pH level Is testing done regularly at the building?	No indoor testing by public water supplier
11. Other plumbing background questions include: <ul style="list-style-type: none"> • Are blueprints of the building available? • Are there known plumbing "dead-ends", low use areas, existing leaks or other "problem areas"? Are renovations planned for any of the plumbing system?	Not all prints are available No dead-end low areas All leaks were identified during walk through and have been repaired No plumbing system renovations

Questions	Answers
Walk-Through	
These questions should be addressed during the walk-through of the facility, while Attachment C- Drinking Water Outlet Inventory is being completed.	
1. Confirm the material of Service Line visually.	Duct iron
2. Confirm the presence of POE or POU treatment.	No POE or POU treatment
3. What are the potable water pipes made of in your facility? <ul style="list-style-type: none">• Lead• Plastic• Galvanized Metal• Cast Iron• Copper• Other Note the water flow through the building and the areas that receive water first, and which areas receive water last.	Cooper Galvanized Metal Brass Water flow through the building shown on the prints
4. Are electrical wires grounded to Water Pipes? Note location(s).	Y / N No No electrical wires grounded to water pipes
5. Are brass fittings, faucets, or valves used in your drinking water system? Note that most faucets are brass on the inside. Document the locations of any brass water outlet to be sampled.	Location: Complete in "Brass" Column in Attachment C- Water Outlet Inventory. Yes Completed in Attachment C - Water Outlet Inventory
6. Locate all drinking water outlets (i.e. water coolers, bubblers, ice machines, kitchen/ food prep sinks, etc.) in the facility.	Complete in Attachment C-Water Outlet Inventory.

Questions	Answers
<p>7. Have the brands and models of the water coolers in the school been compared to the list of recalled water coolers in the Toolkit?</p> <p>Recalled Drinking Water Fountains</p> <p>Make and Model</p>	<p>Y / N Yes all water coolers have been checked and compared to the list of recalled water coolers</p>
<p>8. Have signs of corrosion, such as frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry been detected?</p> <p>Note the locations of water outlets.</p>	<p>Type None on the list of recalled water coolers</p> <p>Complete in "Signs of Corrosion" column in Attachment C- Drinking Water Outlet Inventory.</p>
<p>9. Are there any outlets that are not operational and therefore out of service? Permanently? Temporarily?</p> <p>Permanently</p> <p>Temporarily</p>	<p>Y / N Complete "Operational Column" in Attachment C- Drinking Water Outlet Inventory.</p> <p>Type/ Location Description</p>

Attachment C – Drinking Water Outlet Inventory

Name of School: Horace Mann Community School Address: 25 W 38th Street, Bayonne, New Jersey 07002

Grade Levels: Elementary School Year School Constructed: Unknown Renovated/Additions: NA

Individual School Project Officer: Scott Nolan

Date Completed: 09/30/2022

# ¹	Type	Location	Code	Operational ² (Y/N)	Signs of Corrosion ³ (Y/N)	Filter ⁴ (Y/N)	Brass Fittings, Faucets or valves? (Y/N)	Aerator/ Screen (Y/N)	Motion Activated (Y/N)	Chiller (Y/N)	Water Cooler		Comments
											Make	Model	
01	Sink	Room B4 (PTA)	HM-01	Y	N	N	N	Y	N	N	NA	NA	
02	Sink	Room B4 (PTA)	HM-02	Y	N	N	N	Y	N	N	NA	NA	Flush
03	Water Fountain	Basement Bubbler by Elevator – Left	HM-03	Y	N	Y	N	N	N	N	NA	NA	
04	Water Fountain	Basement Bubbler by Elevator – Right	HM-04	Y	N	Y	N	N	N	N	NA	NA	
05	Sink	Room B1	HM-05	Y	N	N	N	Y	N	N	NA	NA	
06	Sink	Room B11	HM-06	Y	N	N	N	Y	N	N	NA	NA	

¹ Number outlets starting at the closest outlet to the Point of Entry (POE).

² Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

³ Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

⁴ Document on Attachment D- Filter Inventory.

07	Sink	Room 102	HM-07	Y	N	N	N	Y	N	N	NA	NA	
08	Sink	Room 102	HM-08	Y	N	N	N	Y	N	N	NA	NA	Flush
09	Water Fountain	Bubbler by Room 101	HM-09	Y	N	N	N	N	N	N	NA	NA	
10	Sink	Room 101	HM-10	Y	N	N	N	Y	N	N	NA	NA	
11	Water Fountain	Bubbler by Office	HM-11	Y	N	N	N	N	N	N	NA	NA	
12	Sink	Room 114	HM-12	Y	N	N	N	N	N	N	NA	NA	
13	Water Fountain	Teacher Café Water Fountain	HM-13	Y	N	Y	N	N	N	Y	NA	NA	
14	Sink	Teacher Café Faucet	HM-14	Y	N	Y	N	Y	N	N	NA	NA	
15	Sink	Nurse's Office Faucet	HM-15	Y	N	N	N	Y	N	N	NA	NA	
16	Sink	Room 109	HM-16	Y	N	N	N	Y	N	N	NA	NA	
17	Water Fountain	Bubbler by Room 204	HM-17	Y	N	N	N	N	N	N	NA	NA	
18	Water Fountain	Bubbler by Room 217	HM-18	Y	N	N	N	N	N	N	NA	NA	
19	Water Fountain	Bubbler by 213	HM-19	Y	N	N	N	N	N	N	NA	NA	
20	Water Fountain	Bubbler by 303	HM-20	Y	N	N	N	N	N	N	NA	NA	
21	Water Fountain	Bubbler by 317	HM-21	Y	N	N	N	N	N	N	NA	NA	

¹ Number outlets starting at the closest outlet to the Point of Entry (POE).

¹ Document if permanently or temporarily out of service on the Attachment B- Plumbing Profile.

¹ Signs of corrosion detected, such as but not limited to frequent leaks, rust-colored water, or stained fixtures, dishes, or laundry.

¹ Document on Attachment D- Filter Inventory.

Attachment D - Filter Inventory

Name of School: Horace Mann Community School Grade Levels: Elementary School

Address: 25 W 38th Street, Bayonne, New Jersey 07002

Individual School Project Officer: Scott Nolan

Date: 09/30/2022

Sample Location / Code	Brand	Type (Make & Model)	Date Installed or Replaced	Replacement Frequency	NSF Certified for Lead Reduction Y/N
HM-01	Unknown	N/A	N/A	N/A	N/A
HM-02	Unknown	N/A	N/A	N/A	N/A
HM-03	Halsey Taylor	HRFSB	N/A	N/A	N/A
HM-04	Halsey Taylor	HRFSB	N/A	N/A	N/A
HM-05	N/A	N/A	N/A	N/A	N/A
HM-06	N/A	N/A	N/A	N/A	N/A
HM-07	N/A	N/A	N/A	N/A	N/A
HM-08	N/A	N/A	N/A	N/A	N/A
HM-09	N/A	N/A	N/A	N/A	N/A
HM-10	N/A	N/A	N/A	N/A	N/A
HM-11	N/A	N/A	N/A	N/A	N/A
HM-12	N/A	N/A	N/A	N/A	N/A
HM-13	Elkay	N/A	N/A	N/A	N/A
HM-14	3M Aqua Pure	N/A	N/A	N/A	N/A
HM-15	N/A	N/A	N/A	N/A	N/A
HM-16	N/A	N/A	N/A	N/A	N/A
HM-17	N/A	N/A	N/A	N/A	N/A
HM-18	N/A	N/A	N/A	N/A	N/A
HM-19	N/A	N/A	N/A	N/A	N/A
HM-20	N/A	N/A	N/A	N/A	N/A
HM-21	N/A	N/A	N/A	N/A	N/A

Attachment E – Flushing Log

Name of School: Horace Mann Community SchoolAddress: 25 W 38th Street, Bayonne, New Jersey 07002Grade Levels: Elementary SchoolIndividual School Project Officer: Scott NolanDate: 09/30/2022

Sample Location Description	Sample Location Code	Date	Time	Duration of Flushing	Reason for Flushing
Room B4 (PTA)	HM-01	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room B4 (PTA)	HM-02	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Basement Bubbler by Elevator – Left	HM-03	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Basement Bubbler by Elevator – Right	HM-04	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room B1	HM-05	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room B11	HM-06	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 102	HM-07	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 102	HM-08	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Room 101	HM-09	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 101	HM-10	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Office	HM-11	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 114	HM-12	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Teacher Café Water Fountain	HM-13	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Teacher Café Faucet	HM-14	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Nurse's Office Faucet	HM-15	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Room 109	HM-16	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Room 204	HM-17	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by Room 217	HM-18	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by 213	HM-19	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by 303	HM-20	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling
Bubbler by 317	HM-21	August 31, 2022	5:30 pm	2-3 Minutes	Water Sampling

Attachment F - Pre - Sampling Water Use Certification


TO BE COMPLETED BY THE BAYONNE BOE DISTRICT REPRESENTATIVE:		
School Name: <u>Horace Mann Community School</u>		
Sample collection address:	<u>25 W 38th Street, Bayonne, New Jersey 07002</u>	
Water was last used:	<u>Time: 5:30 pm</u>	<u>Date: August 31, 2022</u>
Sample commencement:	<u>Time: 8:58 am</u>	<u>Date: September 01, 2022</u>
I have read the Lead Drinking Water Testing Sampling Plan and Quality Assurance Project Plan and I am certifying that samples were collected in accordance with these plans.		
Scott Nolan	09/30/22	
Signature	Date	


DO NOT DRINK



SAFE FOR HANDWASHING



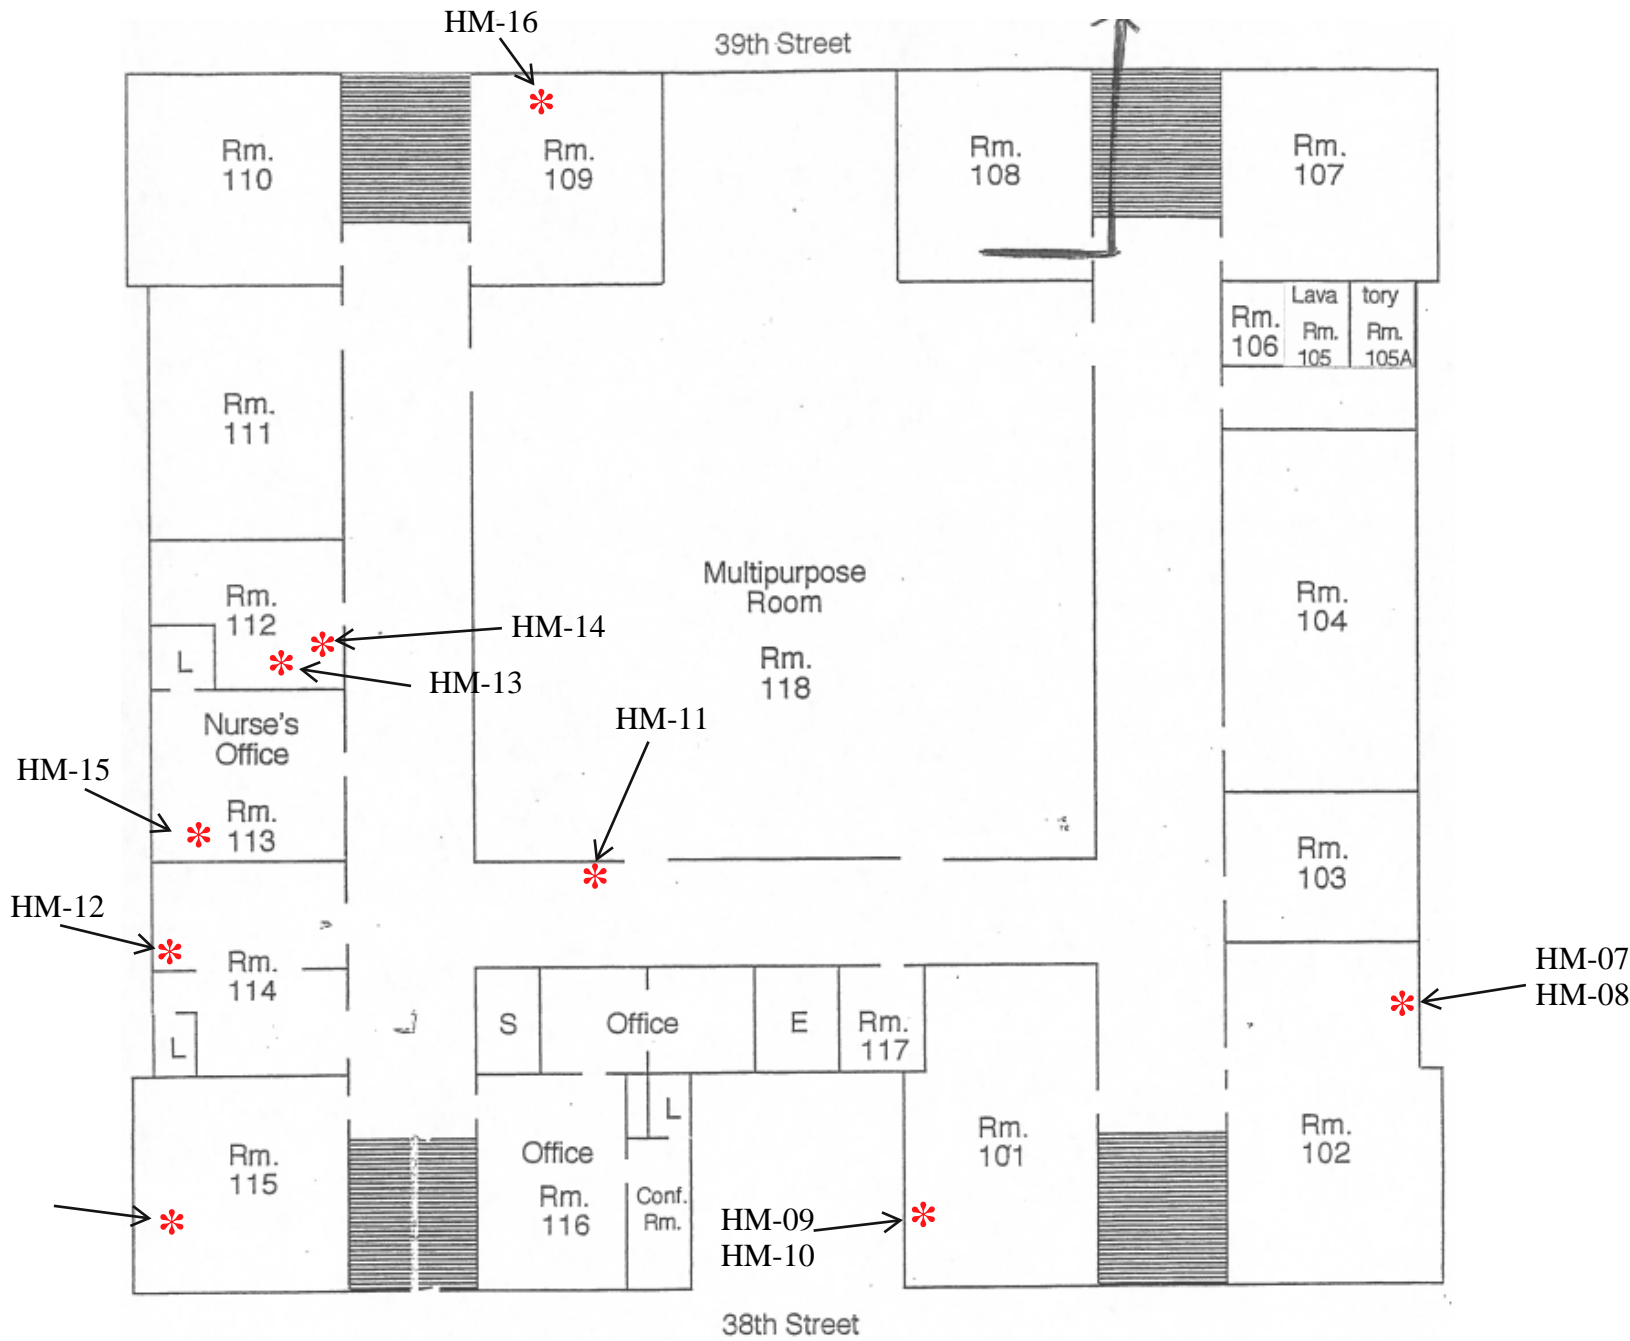

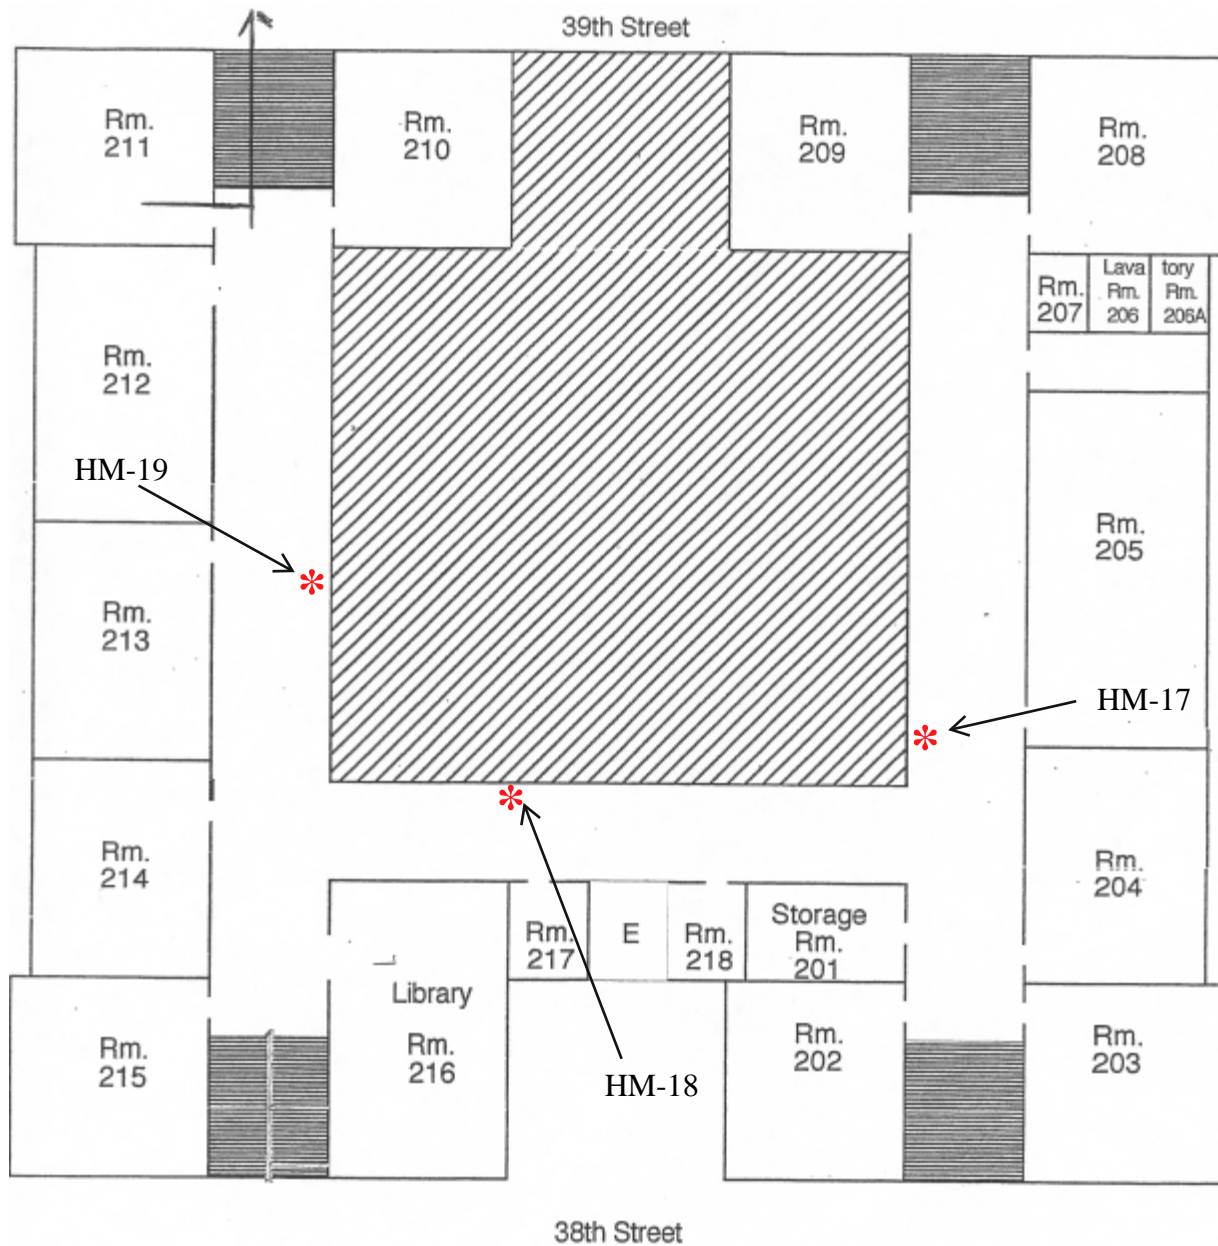

Key:

* = Drinking Water Sampling Location



McCABE
ENVIRONMENTAL SERVICES LLC

464 Valley Brook Avenue, Lyndhurst NJ 07071
129 Sea Girt Avenue, Manasquan NJ 08736
Phone: (800) 423-0766 • Fax: (201) 438-1798
www.mccabeenv.com

Project:
Bayonne Bayonne Board of
Education Horace Mann
Community School Lead in
Drinking Water

Drawing Title:

Horace Mann Community School
Second Floor Sample Locations


Note:

Not To Scale

MES Project Number: 22-04448

Date:

09/09/2022

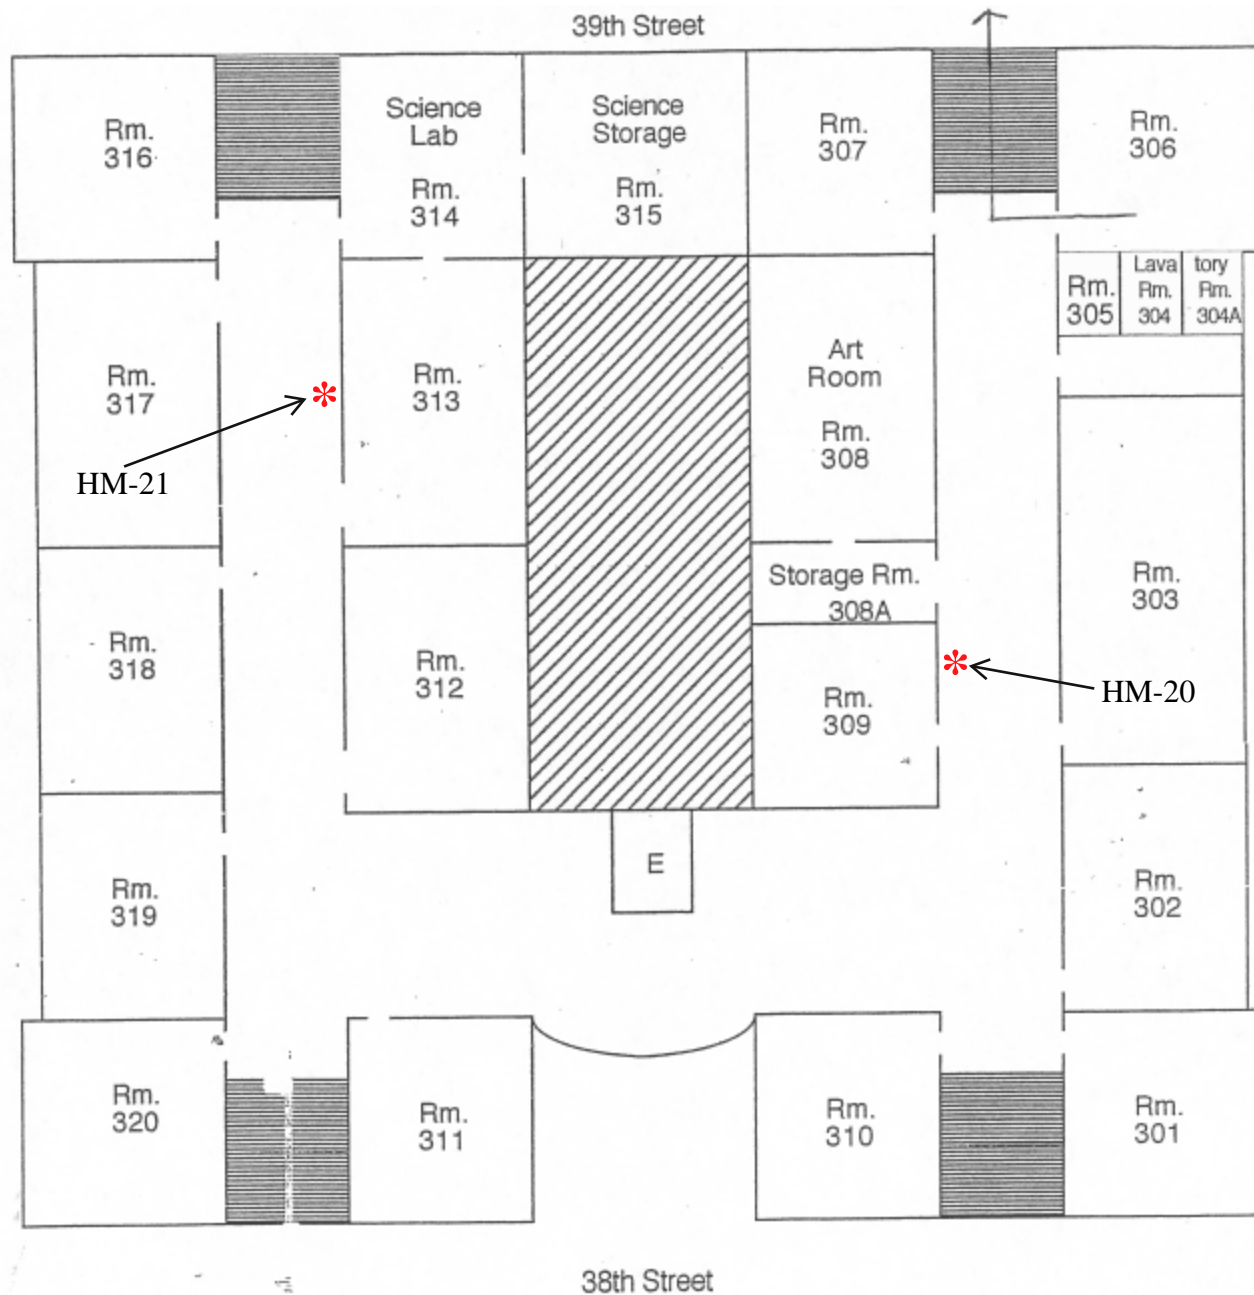

Key:

* = Drinking Water Sampling Location

